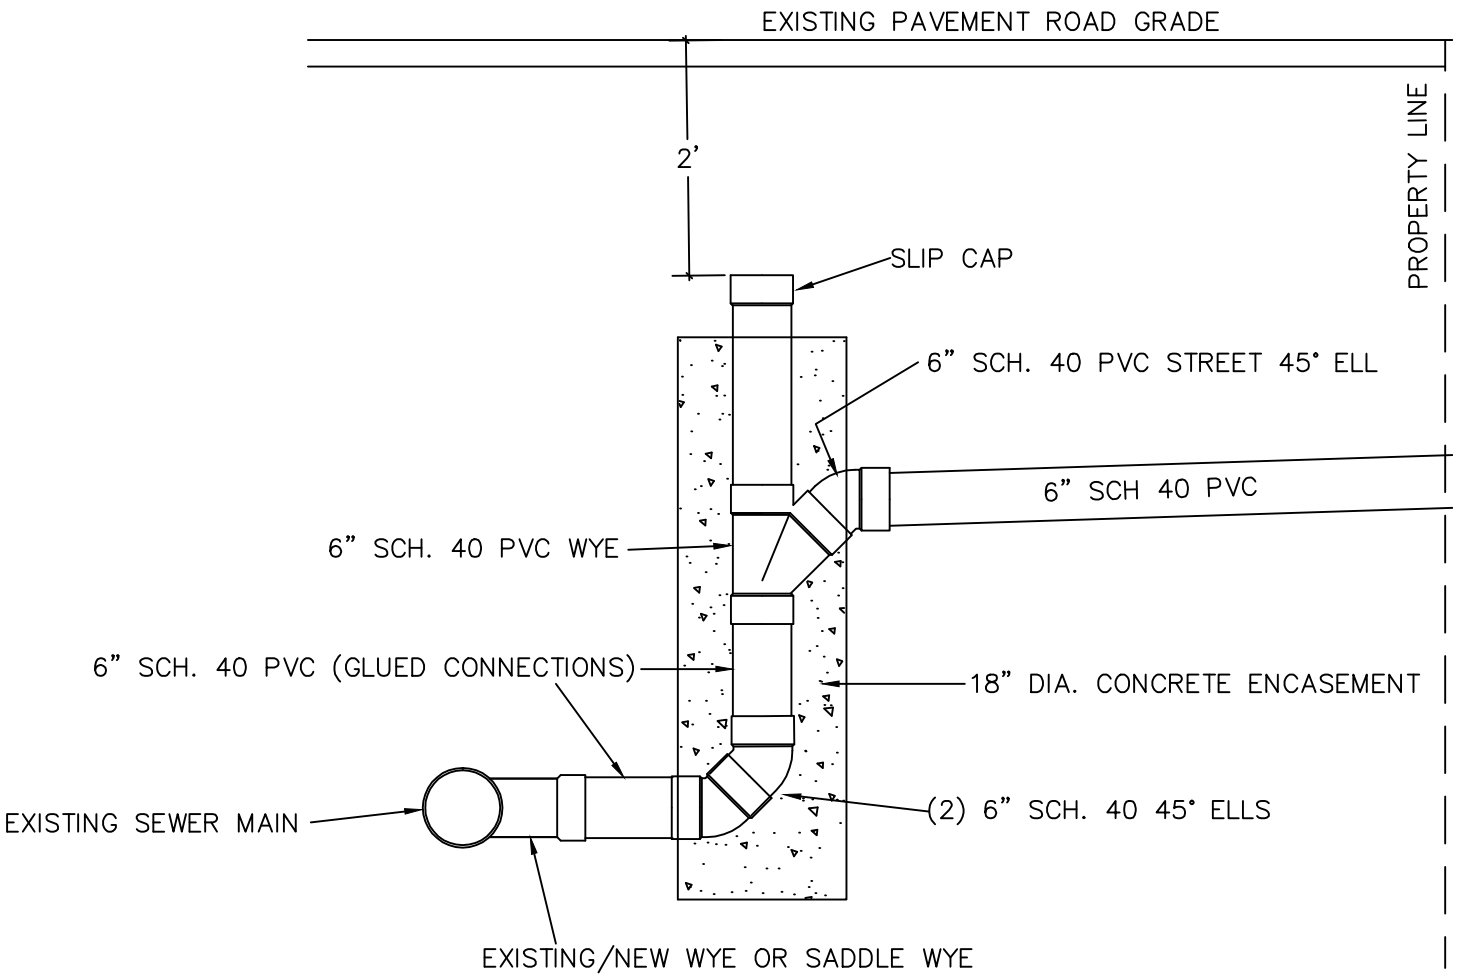


CHIMNEY & CLEANOUT DETAIL 2

N.T.S.

NOTE: SEWER LATERALS SHALL HAVE A MINIMUM 24" SEPARATION VERTICALLY AND 10' SEPARATION HORIZONTALLY FROM ALL WATER SUPPLY LINES

WOONSOCKET STANDARD SANITARY SEWER CHIMNEY & CLEANOUT DETAIL OPTION 2	CITY OF WOONSOCKET, RI DEPARTMENT OF PUBLIC WORKS ENGINEERING DIVISION OCTOBER, 2002